



# Seward Water/Wastewater Department – July 2010

<i>PARAMETER MEASURED</i>	<i>SDW Standards</i>	<i>RO units</i>	<i>Well Water</i>	<i>POE</i>	<i>System</i>
pH (Standard Units)	7.3-8.5	5.5	6.6	7.55 to 7.58	
Nitrate (mg/L)	10	3	~13	6.7 to 9.1	
Average Total Chlorine (mg/L)	0.1 - 4.0	NA	NA	.113 – 1.03	.15 - .22
Hardness (Grains per Gallon)	NS	0	24	8 – 12	8 – 12
Water Temperature (Fahrenheit)	NS	NA	49 - 55 F	~52° F	50°~60°
<i>WELL WATER PRODUCTION (Gallons)</i>	<i>WELL HIGH DAY</i>	<i>WELL YEAR TO DATE</i>	<i>WELL LAST YEAR</i>	<i>RECOVERY</i>	<i>BLEND</i>
2,839,452	1,317,052	266,125,000	284,953,000	80%	50%

**Water Pumped**

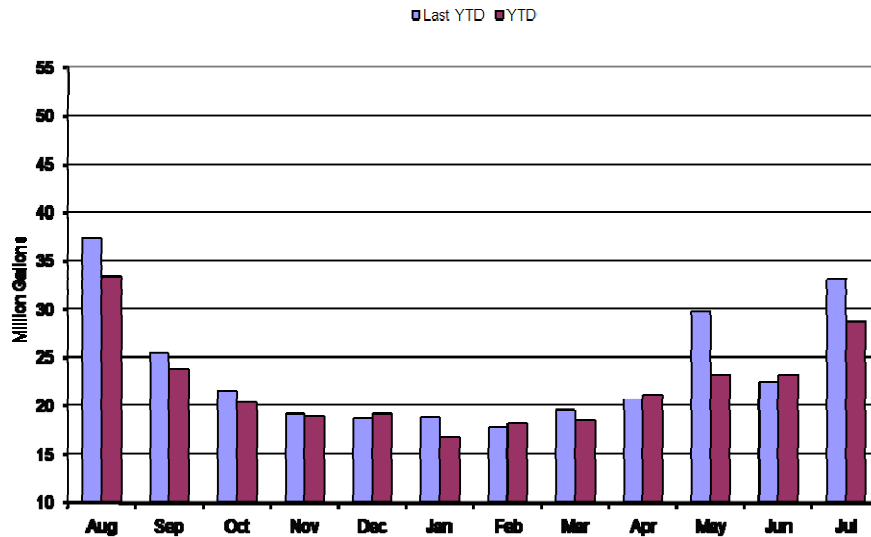

**Precipitation**

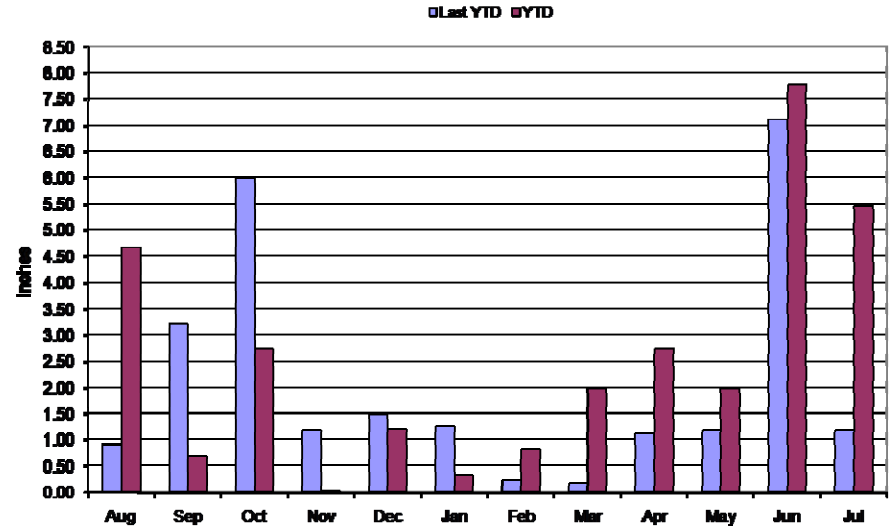

<i>WASTEWATER TREATED (Gallons)</i>	<i>High Day</i>	<i>Average</i>	<i>Minimum</i>	<i>Sludge Loads Hauled</i>
28,424,200	2,009,000	916,900	473,600	47,700

POE = Point of entry into system